

Floodlight Summary:

Report based on lamp delivering 1000 lumens.

Maximum Intensity	2479.6 cd per klm.
(Luminaire orientation as tested.)	0.0 degrees vertical
	0.0 degrees horizontal

Beam Spread	At 10% of Imax	50.9V x 50.0H
	At 50% of Imax	27.3V x 27.1H
	At 90% of Imax	11.2V x 11.4H

Beam Flux	Total	652.8 lumens per klm.
	To 10% of Imax	556.6 lumens per klm.
	To 50% of Imax	316.9 lumens per klm.
	To 90% of Imax	70.0 lumens per klm.

Upward LOR	0.0 %
Downward LOR	65.3 %


Luminaire Efficiency (Light Output Ratio)	65.0 %
---	--------

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators:
Test Date: 29 August 2022

γ Range: 0 - 90DEG
γ Interval: 2.5DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.456
Humidity: 65.0%
Test Distance: 6.265m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

NAME: 93SS1030/BL	TYPE: 93SS1030/BL	WEIGHT: 1
SPEC.:	DIM.: 40 x 75 x 40	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: circle	Shielding Angle:



DATA OF LAMP		PHOTOMETRIC DATA	
MODEL	93SS1030/BL	Imax (cd)	1984
NOMINAL POWER (W)	10	AVAILABILITY (%)	55.7
RATED VOLTAGE (V)	230	Avai. FLUX (lm)	445.2
NOMINAL FLUX (lm)	800	LOR (%)	65.0
LAMPS INSIDE	1	TOTAL FLUX (lm)	520.3
TEST VOLTAGE (V)	230	θ @50% (H,V)	27,27DEG

VERTICAL (DEG)	AREA FLUX DIAGRAM																UNIT:lm		Φ t	Φ a
	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.00
70	0.00	0.00	0.00	0.00	0.01	0.01	0.02	0.02	0.02	0.02	0.02	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.14	0.00
60	0.00	0.00	0.00	0.01	0.01	0.02	0.03	0.04	0.06	0.06	0.04	0.03	0.02	0.01	0.01	0.00	0.00	0.00	0.35	0.00
50	0.00	0.00	0.00	0.01	0.02	0.05	0.13	0.26	0.37	0.37	0.25	0.12	0.05	0.02	0.01	0.00	0.00	0.00	1.67	0.00
40	0.00	0.00	0.01	0.02	0.04	0.17	0.52	1.01	1.42	1.40	0.95	0.48	0.16	0.04	0.01	0.01	0.00	0.00	6.21	0.00
30	0.00	0.00	0.01	0.02	0.10	0.44	1.44	3.80	6.45	6.32	3.61	1.35	0.40	0.09	0.02	0.01	0.00	0.00	24.1	10.5
20	0.00	0.00	0.01	0.03	0.17	0.83	3.44	11.2	24.0	23.4	10.3	3.25	0.78	0.16	0.03	0.01	0.00	0.00	77.6	69.4
10	0.00	0.00	0.01	0.03	0.23	1.20	5.58	22.8	49.7	49.0	21.3	5.24	1.13	0.22	0.03	0.01	0.00	0.00	156	149
0	0.00	0.00	0.01	0.03	0.23	1.20	5.50	22.0	47.8	47.4	20.9	5.19	1.14	0.22	0.04	0.01	0.00	0.00	152	144
-10	0.00	0.00	0.01	0.03	0.17	0.81	3.30	10.5	21.8	21.3	9.91	3.15	0.78	0.16	0.03	0.01	0.00	0.00	71.9	63.4
-20	0.00	0.00	0.01	0.02	0.09	0.42	1.36	3.46	5.84	5.78	3.39	1.31	0.40	0.10	0.02	0.01	0.00	0.00	22.2	8.19
-30	0.00	0.00	0.01	0.02	0.04	0.16	0.48	0.93	1.31	1.31	0.91	0.46	0.16	0.05	0.01	0.01	0.00	0.00	5.83	0.00
-40	0.00	0.00	0.00	0.01	0.02	0.04	0.12	0.24	0.34	0.34	0.23	0.12	0.05	0.02	0.01	0.00	0.00	0.00	1.56	0.00
-50	0.00	0.00	0.00	0.01	0.01	0.02	0.03	0.05	0.06	0.05	0.05	0.04	0.02	0.02	0.01	0.00	0.00	0.00	0.37	0.00
-60	0.00	0.00	0.00	0.00	0.01	0.01	0.03	0.04	0.04	0.03	0.03	0.03	0.02	0.01	0.00	0.00	0.00	0.00	0.24	0.00
-70	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.06	0.00
-80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	-90	-80	-70	-60	-50	-40	-30	-20	HORIZONTAL (DEG)	20	30	40	50	60	70	80	90			
Φ t	0.00	0.01	0.08	0.23	1.15	5.38	22.0	76.4	159	157	71.9	20.8	5.13	1.12	0.23	0.07	0.01	0.00	520	---
Φ a	0.00	0.00	0.00	0.00	0.00	0.00	8.21	67.3	151	149	62.6	7.01	0.00	0.00	0.00	0.00	0.00	0.00	---	445

one-half-peak spread: U:13.3,D:14.1 , L:13.9,R:13.4


NEMA Beam Type: Type 4

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:
Test Date:29 August 2022

γ Range: 0 - 90DEG
γ Interval: 2.5DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:6.265m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

NAME: 93SS1030/BL	TYPE: 93SS1030/BL	WEIGHT: 1
SPEC.:	DIM.: 40 x 75 x 40	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: circle	Shielding Angle:




C Range: 0 - 360DEG
 C Interval: 10.0DEG
 Test Speed: HIGH
 Temperature:25.3°C
 Operators:
 Test Date:29 August 2022

γ Range: 0 - 90DEG
 γ Interval: 2.5DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.456
 Humidity:65.0%
 Test Distance:6.265m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM


NAME: 93SS1030/BL	TYPE: 93SS1030/BL	WEIGHT: 1
SPEC.:	DIM.: 40 x 75 x 40	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: circle	Shielding Angle:



C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators:
Test Date: 29 August 2022

γ Range: 0 - 90DEG
γ Interval: 2.5DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.456
Humidity: 65.0%
Test Distance: 6.265m [K=1.0000]
Remarks:

Planar Illuminance Curve




C Range: 0 - 360DEG
 C Interval: 10.0DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators:
 Test Date: 29 August 2022

γ Range: 0 - 90DEG
 γ Interval: 2.5DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.456
 Humidity: 65.0%
 Test Distance: 6.265m [K=1.0000]
 Remarks:

AAI Figure

NAME: 93SS1030/BL	TYPE: 93SS1030/BL	WEIGHT: 1
SPEC.:	DIM.: 40 x 75 x 40	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: circle	Shielding Angle:

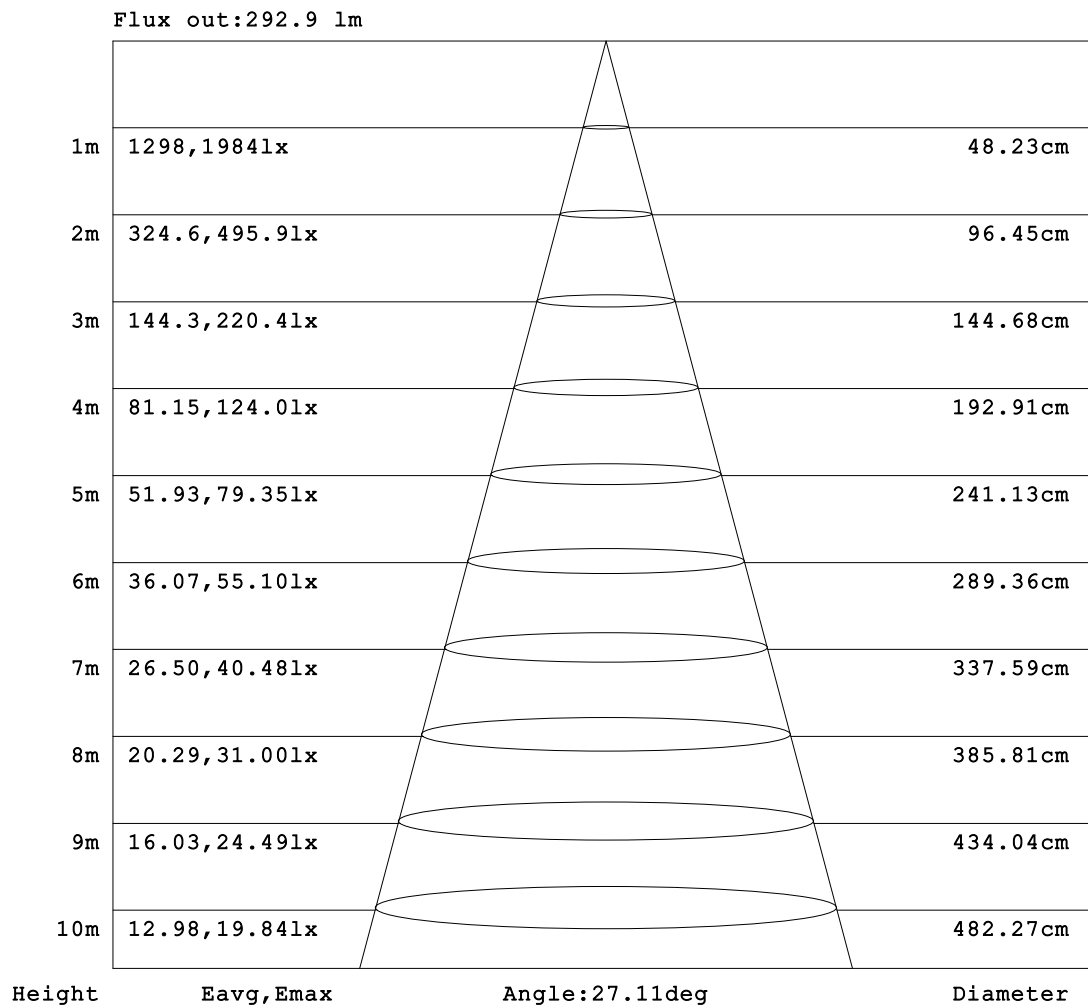

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 10.0DEG
 Test Speed: HIGH
 Temperature:25.3°C
 Operators:
 Test Date:29 August 2022

γ Range: 0 - 90DEG
 γ Interval: 2.5DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.456
 Humidity:65.0%
 Test Distance:6.265m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME: 93SS1030/BL	TYPE: 93SS1030/BL	WEIGHT: 1
SPEC.:	DIM.: 40 x 75 x 40	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: circle	Shielding Angle:

Table--1

UNIT: cd

H(DEC) V(DEC)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.01	0.00	0.00
-80	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.00	0.01	0.02	0.02	0.01	0.02	0.04	0.02	0.01
-75	0.01	0.00	0.00	0.00	0.01	0.01	0.00	0.01	0.03	0.03	0.02	0.04	0.06	0.07	0.06	0.08	0.10	0.09	0.08
-70	0.01	0.00	0.00	0.00	0.02	0.02	0.01	0.03	0.06	0.08	0.10	0.25	0.57	0.76	0.86	0.93	0.99	1.00	0.99
-65	0.01	0.00	0.00	0.01	0.02	0.03	0.04	0.07	0.15	0.26	0.33	0.49	0.74	0.92	1.13	1.26	1.33	1.28	1.18
-60	0.01	0.00	0.00	0.01	0.03	0.05	0.08	0.22	0.33	0.41	0.52	0.67	0.85	1.03	1.28	1.38	1.38	1.32	1.24
-55	0.01	0.00	0.00	0.01	0.04	0.09	0.25	0.37	0.48	0.61	0.75	0.89	1.04	1.19	1.31	1.47	1.58	1.61	1.61
-50	0.01	0.00	0.00	0.01	0.05	0.19	0.39	0.51	0.66	0.80	0.93	1.11	1.34	1.69	2.06	2.82	3.53	3.81	3.67
-45	0.01	0.00	0.00	0.02	0.08	0.34	0.51	0.67	0.83	0.98	1.17	1.52	2.16	3.90	5.75	7.52	9.23	10.2	10.3
-40	0.01	0.00	0.00	0.02	0.11	0.41	0.64	0.83	1.00	1.21	1.67	2.94	5.15	7.98	11.6	15.9	20.5	23.7	25.3
-35	0.01	0.00	0.01	0.03	0.21	0.48	0.75	0.98	1.16	1.60	3.01	5.73	9.42	16.1	23.9	29.7	35.6	38.7	40.4
-30	0.01	0.00	0.01	0.05	0.29	0.55	0.84	1.10	1.37	2.32	5.40	9.60	18.1	29.4	40.9	55.4	71.3	81.6	86.0
-25	0.01	0.00	0.01	0.06	0.35	0.60	0.94	1.16	1.67	3.89	8.17	15.1	28.1	45.7	72.6	110	155	188	200
-20	0.01	0.00	0.01	0.07	0.38	0.66	1.00	1.22	2.02	5.62	11.2	22.5	41.7	72.7	126	205	281	348	373
-15	0.01	0.00	0.02	0.08	0.40	0.70	1.02	1.33	2.74	7.11	14.7	30.1	58.3	113	204	336	512	710	776
-10	0.01	0.00	0.02	0.09	0.42	0.73	1.04	1.40	3.36	8.49	18.9	37.5	77.7	152	287	525	906	1232	1369
-5	0.01	0.01	0.02	0.10	0.42	0.74	1.04	1.43	3.74	9.49	21.4	42.8	94.7	189	362	736	1265	1663	1783
0	0.01	0.01	0.02	0.10	0.42	0.74	1.04	1.43	3.85	9.94	22.3	44.1	101	204	399	843	1434	1847	1984
5	0.01	0.01	0.02	0.10	0.42	0.73	1.04	1.42	3.68	9.53	21.6	42.8	94.7	189	369	770	1321	1730	1867
10	0.01	0.01	0.03	0.10	0.42	0.71	1.03	1.38	3.25	8.56	19.2	37.8	79.2	160	296	558	984	1349	1472
15	0.01	0.01	0.03	0.10	0.41	0.67	1.01	1.31	2.63	7.25	15.1	30.7	59.5	116	216	357	561	787	873
20	0.01	0.01	0.03	0.09	0.41	0.61	0.96	1.18	1.92	5.74	11.7	23.3	42.6	76.6	137	221	307	378	399
25	0.01	0.01	0.03	0.08	0.40	0.54	0.87	1.09	1.57	3.90	8.62	16.0	29.6	48.5	77.2	124	172	211	223
30	0.01	0.01	0.03	0.07	0.37	0.49	0.76	0.98	1.30	2.24	5.66	10.4	19.4	31.1	43.8	61.1	77.6	91.3	93.4
35	0.01	0.01	0.02	0.06	0.25	0.43	0.64	0.88	1.11	1.55	3.12	6.27	10.4	17.5	25.6	32.0	38.3	42.1	44.0
40	0.01	0.01	0.02	0.06	0.14	0.37	0.52	0.77	0.96	1.20	1.69	3.16	5.67	8.97	13.0	17.1	21.7	24.8	26.6
45	0.01	0.01	0.02	0.05	0.09	0.30	0.43	0.65	0.83	0.98	1.17	1.60	2.31	4.35	6.50	8.43	10.2	11.3	11.1
50	0.01	0.01	0.02	0.04	0.06	0.16	0.35	0.51	0.69	0.80	0.95	1.11	1.37	1.74	2.17	3.11	3.81	4.09	4.05
55	0.01	0.01	0.02	0.03	0.04	0.08	0.24	0.38	0.51	0.64	0.77	0.91	0.99	1.09	1.18	1.38	1.55	1.66	1.69
60	0.01	0.01	0.02	0.02	0.03	0.05	0.10	0.24	0.34	0.43	0.56	0.68	0.76	0.81	0.87	0.91	0.92	0.96	0.99
65	0.01	0.01	0.02	0.02	0.01	0.03	0.06	0.09	0.16	0.28	0.35	0.42	0.49	0.54	0.60	0.62	0.62	0.66	0.69
70	0.01	0.01	0.02	0.02	0.01	0.02	0.04	0.05	0.05	0.08	0.12	0.19	0.25	0.30	0.34	0.35	0.34	0.36	0.38
75	0.01	0.01	0.01	0.01	0.01	0.01	0.03	0.03	0.02	0.03	0.06	0.05	0.05	0.07	0.09	0.08	0.08	0.09	0.10
80	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.01	0.01	0.01	0.03	0.02	0.01	0.02	0.04	0.03	0.02	0.03	0.04
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.01	0.01	0.01	0.02	0.01	0.01	0.01	0.02
90	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:
Test Date:29 August 2022

γ Range: 0 - 90DEG
γ Interval: 2.5DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:6.265m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME: 93SS1030/BL	TYPE: 93SS1030/BL	WEIGHT: 1
SPEC.:	DIM.: 40 x 75 x 40	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: circle	Shielding Angle:

Table--2

UNIT: cd

H (DEG) V (DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
-85	0.01	0.01	0.01	0.00	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
-80	0.02	0.04	0.02	0.01	0.02	0.03	0.01	0.00	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
-75	0.08	0.09	0.07	0.05	0.06	0.06	0.04	0.02	0.02	0.03	0.01	0.00	0.01	0.01	0.00	0.00	0.00	0.00	
-70	0.94	0.89	0.88	0.87	0.84	0.72	0.41	0.11	0.06	0.05	0.02	0.01	0.01	0.01	0.00	0.00	0.00	0.00	
-65	1.14	1.10	1.03	1.00	0.98	0.92	0.85	0.75	0.61	0.24	0.05	0.03	0.02	0.02	0.00	0.00	0.00	0.00	
-60	1.18	1.12	1.08	1.06	1.04	0.98	0.90	0.86	0.77	0.67	0.42	0.06	0.04	0.02	0.00	0.00	0.00	0.00	
-55	1.59	1.55	1.47	1.28	1.21	1.09	0.94	0.84	0.75	0.71	0.66	0.38	0.07	0.03	0.01	0.00	0.00	0.00	
-50	3.70	3.42	2.85	2.22	1.93	1.62	1.26	1.01	0.83	0.68	0.63	0.53	0.20	0.04	0.01	0.00	0.00	0.00	
-45	10.1	8.97	7.27	5.72	4.00	2.54	1.99	1.38	1.02	0.77	0.62	0.52	0.43	0.05	0.01	0.00	0.00	0.00	
-40	23.5	20.0	15.2	11.3	7.89	5.23	3.28	2.13	1.37	0.97	0.70	0.53	0.44	0.09	0.01	0.01	0.00	0.00	
-35	38.4	34.8	29.1	23.1	15.6	9.24	5.83	3.33	2.04	1.16	0.83	0.59	0.44	0.24	0.02	0.01	0.00	0.00	
-30	89.1	69.4	53.6	39.3	28.3	17.4	9.34	5.39	2.69	1.57	0.96	0.66	0.48	0.38	0.03	0.01	0.00	0.00	
-25	186	152	111	68.9	43.5	27.1	14.7	7.93	3.92	2.04	1.06	0.74	0.51	0.43	0.05	0.02	0.01	0.00	
-20	341	274	198	123	71.0	39.0	22.0	10.7	5.55	2.42	1.18	0.81	0.54	0.44	0.06	0.02	0.01	0.00	
-15	692	485	315	194	107	55.2	28.4	14.0	6.92	3.02	1.50	0.87	0.58	0.45	0.07	0.02	0.01	0.00	
-10	1223	880	487	269	148	74.2	35.6	18.3	8.09	3.56	1.73	0.91	0.61	0.46	0.08	0.02	0.01	0.00	
-5	1650	1237	701	332	179	90.8	40.5	20.8	8.93	3.95	1.87	0.94	0.64	0.48	0.08	0.03	0.01	0.00	
0	1829	1385	802	359	194	95.3	41.4	21.8	9.28	4.14	1.93	0.95	0.65	0.49	0.09	0.03	0.01	0.00	
5	1708	1275	715	333	182	89.8	40.0	20.5	8.71	3.87	1.84	0.92	0.64	0.49	0.09	0.03	0.01	0.00	
10	1327	942	495	273	152	74.4	35.5	17.8	7.68	3.41	1.66	0.89	0.61	0.49	0.09	0.03	0.01	0.00	
15	765	514	327	204	110	55.5	29.0	13.8	6.61	2.90	1.40	0.84	0.59	0.49	0.08	0.03	0.01	0.00	
20	363	291	210	130	71.3	40.0	21.9	10.6	5.35	2.32	1.08	0.78	0.56	0.48	0.08	0.03	0.01	0.00	
25	207	166	116	72.7	44.8	27.5	14.6	7.71	3.80	1.98	0.95	0.69	0.52	0.48	0.07	0.03	0.01	0.00	
30	88.8	74.7	56.7	40.6	29.0	18.0	9.39	5.11	2.53	1.44	0.82	0.59	0.48	0.43	0.06	0.03	0.01	0.00	
35	42.1	37.0	30.0	23.7	16.3	9.49	5.78	3.12	1.82	0.97	0.71	0.52	0.41	0.26	0.05	0.02	0.01	0.00	
40	24.6	21.1	16.3	12.2	8.27	5.26	3.17	1.97	1.11	0.81	0.59	0.46	0.36	0.11	0.05	0.02	0.01	0.00	
45	11.2	9.98	8.00	6.13	4.14	2.50	1.80	1.13	0.84	0.66	0.50	0.37	0.28	0.06	0.04	0.02	0.01	0.00	
50	4.15	3.82	3.07	2.28	1.88	1.38	0.99	0.81	0.64	0.51	0.41	0.29	0.12	0.04	0.03	0.02	0.01	0.00	
55	1.69	1.58	1.37	1.11	0.98	0.85	0.74	0.61	0.49	0.40	0.31	0.19	0.05	0.03	0.02	0.02	0.00	0.00	
60	0.95	0.91	0.86	0.78	0.69	0.61	0.56	0.47	0.35	0.27	0.19	0.07	0.03	0.01	0.02	0.01	0.00	0.00	
65	0.65	0.60	0.57	0.54	0.50	0.43	0.36	0.29	0.21	0.12	0.07	0.05	0.02	0.01	0.01	0.01	0.00	0.00	
70	0.36	0.33	0.32	0.29	0.25	0.20	0.15	0.09	0.06	0.04	0.04	0.03	0.01	0.00	0.01	0.01	0.00	0.00	
75	0.09	0.07	0.08	0.08	0.06	0.04	0.04	0.04	0.02	0.01	0.02	0.02	0.01	0.00	0.01	0.01	0.00	0.00	
80	0.03	0.02	0.03	0.03	0.02	0.01	0.02	0.03	0.01	0.00	0.01	0.01	0.01	0.00	0.01	0.01	0.00	0.00	
85	0.01	0.01	0.01	0.02	0.01	0.01	0.01	0.01	0.01	0.00	0.01	0.01	0.00	0.00	0.00	0.01	0.00	0.00	
90	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.00	

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:
Test Date:29 August 2022

γ Range: 0 - 90DEG
γ Interval: 2.5DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:6.265m [K=1.0000]
Remarks: